


LIBERTY LAKE SEWER AND WATER DISTRICT
STANDARD CONSTRUCTION SPECIFICATIONS 2019
AMENDEMENT 2

This amendment modifies the requirements specified in the "LIBERTY LAKE SEWER AND WATER DISTRICT; STANDARD CONSTRUCTION SPECIFICATIONS, 2019"

Standard Plans:

Standard Plans 7-15-A has been modified and is included in this amendment.

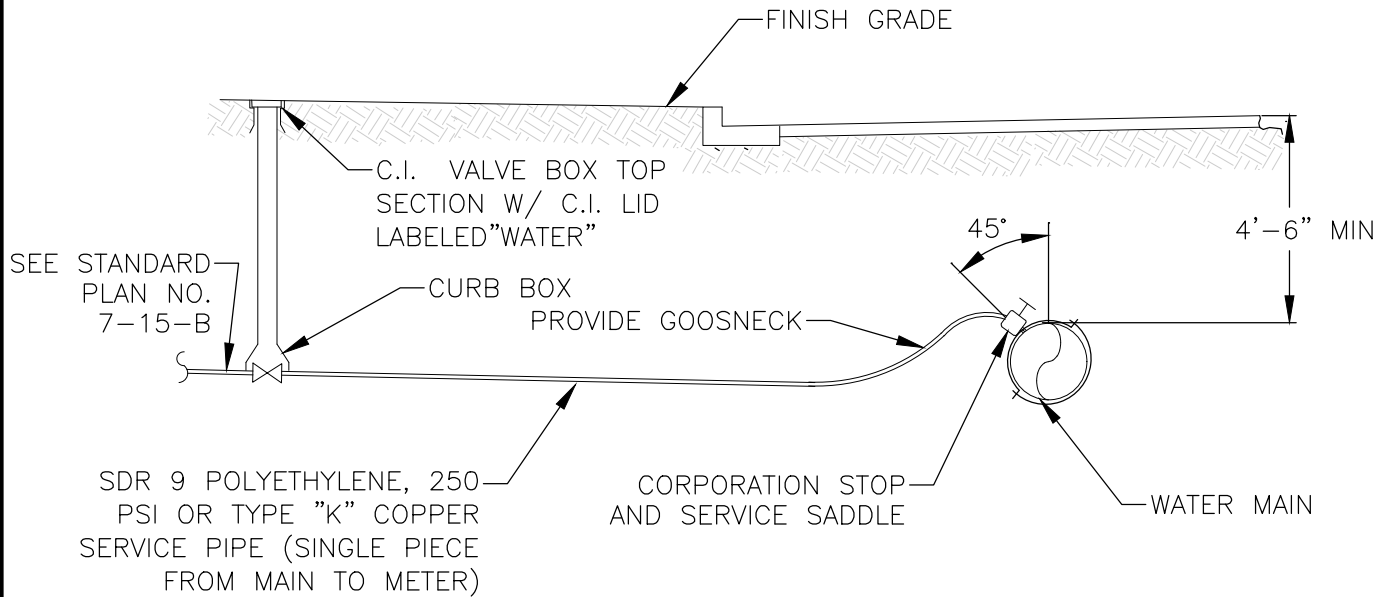

NOTES:

1. IF SERVICES ARE NOT CONNECTED TO A METER BOX OR VAULT, THE END OF THE SERVICE LINE SHALL BE CAPPED AND MARKED WITH A BLUE 2X4 PER STANDARD PLAN NO. 7-18-C.
2. TONING WIRE REQUIRED OVER POLYETHYLENE PIPE.

SERVICE TAP (1", 1½", 2")

SERVICE TAP COMPONENTS				
SERVICE TAP SIZE	TAPPING SADDLE	CORPORATION STOP	CURB STOP	VALVE BOX (CURB STOP)
1-INCH	ROMAC 202S 1" IP	MUELLER B-25028N1	MUELLER B-25209N1	TYLER (DOMESTIC) T650095-E
1½-INCH	ROMAC 202S 1-1/2" IP	MUELLER B-25028N1-1/2	MUELLER B-25209N1-1/2	TYLER (DOMESTIC) T650095-E
2-INCH	ROMAC 202S 2" IP	MUELLER B-25028N2	MUELLER B-25209N2	TYLER (DOMESTIC) T650095-E

NOTE: ALTERNATE COMPONENTS WILL ONLY BE ALLOWED IF SUBMITTED AND APPROVED IN ADVANCE BY THE LIBERTY LAKE SEWER AND WATER DISTRICT.

SCALE: NONE
 ADOPTED: JUNE 2021

WATER SERVICE CONNECTIONS

REVISED: 12/4/2020
 SUPERSEDES: DECEMBER 2020

LIBERTY LAKE SEWER & WATER DISTRICT

STANDARD PLAN No. 7-15-A